

Acme Sanitary Ware Co. Ltd.

1/F, Acme Building, 22-28 Nanking Street, Kowloon, Hong Kong Tel: 2388 7171 Fax: 2710 8012 Email: acme@acmesanitary.com.hk Website: www.acmesanitary.com.hk



Raising The Standard

PROJECT	REF	REV	ITEM CODE	
LOCATION	DATE		PAGE	

SANITARY WARE SPECIFICATION SHEET

Item Descriptions American Standard (Thailand) "Acacia Evolution"
Wall hung **double vortex** watercloset with slow closing seat & cover; Aqua Ceramic &

ComfortClean Technology against stain, bacteria and germs; tested on BS 3402:1969, HTM 64, BS EN 997:2012+A1:2015 & Modifed ISO 22196;

test report J25282A, J25282B & IMSL

2015/11/002.1B; **3/4.8 LPF** in WELS **Grade 1**;

Registration No. WC 20-0055

Dimensions W376 x L555 x H360 mm

Model TF3119 (Bowl)

640000S (Seat & Cover)

Material Vitreous China

Manufacturer American Standard (Thailand)

Supplier Acme Sanitary Ware Co. Ltd

Mr. Eric Wong/ Mr. Wilson Hung

Contact Tel/Fax (852) 2388-7171 / (852) 2710-8012


E-mail acme@acmesanitary.com.hk
Website www.acmesanitary.com.hk

Acacia Evolution


Collection

Aesthetically pleasing and intuitive, the Acacia Evolution collection reflects an inherent understanding of form and function. Acacia Evolution's considered, modern design is expressed in soft lines and balanced proportions which create a sense of tranquility and calm.







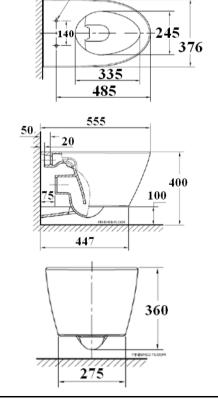

Ø15x2

Note: New Code: CL3119B-6DACTPT

^{*} All information of the above is for the reference only. No prior notice is made if any changes.



MAXIMUM FLUSHING PERFORMANCE. MINIMUM WATER USAGE

The design of the bowl propels the water forward and creates a strong flushing momentum.



Momentum and power are created by the The resulting 'vortex' of water cleans the design of the bowl and force of the water. entire surface of the bowl.



HYGIENIC AND EASY TO CLEAN

Double Vortex is a rimless flushing system that effectively cleans the entire bowl interior, preventing dirt and deposits from building up. This rimless design makes it easy to clean as no dirt can accumulate over time.





All water flows out from the top of the bowl, cleaning the inner surface of the bowl.



Experience Double Vortex Here







100% of the water is ejected through two

ANTI-STAIN TECHNOLOGY

AQUA CERAMIC

Less Dirt Stains. Less Water Stains.



This award-winning super-hydrophilic technology prevents dirt and dark ring stains from sticking to ceramic surfaces. In fact, dirt glides off the surface effortlessly as Aqua Ceramic enables water to penetrate between the contaminants and the toilet surface, effectively lifting off that waste with every flush.

AQUA CFRAMIC is the first material in the world that is able to address the four main issues that affect the cleanliness of toilets: scuffing and scratching, marks from waste, stains caused by prolonged exposure to hard water, and the build-up of bacteria.

The technology incorporates super-hydrophilic performance in the surface of the ceramic, which permits the rinse water to permeate beneath any waste that may have become attached to the ceramic. And as the stain relinquishes its hold, the water simply lifts it and flushes it away.










ComfortClean

Effectively kills E.Coli bacteria according to tests done with the Industrial Microbiological Service Ltd (IMSL).



COMFORTCLEAN

Effectively kills E. Coli bacteria according to tests done with IMSL.



ComfortClean **Antibacterial Technology**

Long-lasting Protection Against Bacteria and Germs.

American Standard ComfortClean technology: A revolutionary ceramic glaze with zinc oxide that effectively kills E. coli bacteria inside the toilet bowl for the long term and beyond, as proven in tests conducted by Industrial Microbiological Services Limited (IMSL).










ComfortClean Antibacterial Glaze is fired into the ceramic at more than 1000°C, ensuring long-lasting effectiveness.




ANTI-BACTERIAL FINISH

TOTAL HYGIENE PROTECTION

American Standard's anti-bacterial finish covers all essential touch points, including the push button, seat and cover to provide an ultimate hygienic environment.



Over time, bacteria breeds on a conventional toilet's surface.



With Anti-bacterial finish, it effectively inhibits the growth of bacteria.

Antimicrobial test result example (24 hours later)

ANTIMICROBIAL PRODUCTS Colon Bacilli Staphylococcus Aureus Multiplication Multiplication




^{*}Japan Industrial Standard (JIS Z 2801:2010) is the standard established by Japan Industrial Standard to test for anti-bacterial activity and efficacy.





American Standard is the first in the industry to meet the *Japan Industrial Standard (JIS Z 2801:2010) for this anti-bacterial technology on the push button. This technology is also applied on the seat and cover to provide a more hygienic environment.

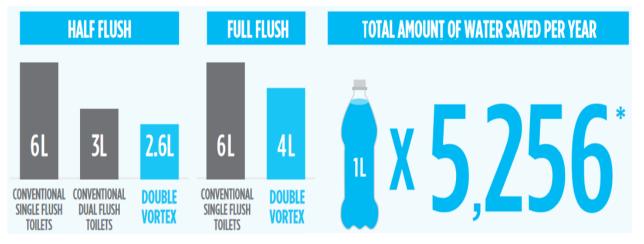


LIXIL Link to Good Living

About LIXIL

LIXIL is the most comprehensive and connected global company in the housing and building industry, delivering human-centric innovation that enhances people's living spaces – we call this Living Technology.

Delivering core strengths in water, housing, building and kitchen technologies, our brand portfolio businesses including LIXIL, INAX, GROHE, American Standard Brands and Permasteelisa are leaders in the industries and regions in which they operate, bringing better living solutions to the world today and for future generations.

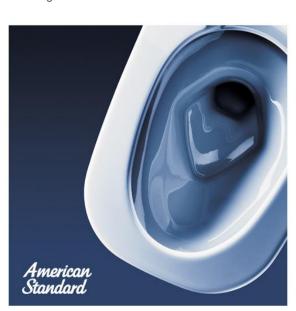



The anti-bacterial innovation is applied as a glaze on ceramic wares, and is certified by the Industrial Microbiological Service Ltd (IMSL) in UK. The anti-bacterial feature cannot be removed even by household detergents, providing a lifetime of hygiene protection.

Good Design Award 2014

American Standard wins 2014 Good Design Award for its Acacia Evolution basin mixer.





註冊號碼 (Registration No.): WC 20-0055



自願參與用水效益標籤計劃 - 水廁 Voluntary Water Efficiency Labelling Scheme - Water Closets



茲證明 This is to certify that

(3119-WT(G1)=TF-3119)

將下列水廁在本計劃內註冊:

has registered the following water closet under this scheme:

子 / Brand : American Standard

: 3119-WT (G1) 號 / Model

: Water Closet Pan 類 / Category

原產地 / Country or Region Origin : Thailand

在用水效益標籤上展示的標誌

滴水點 Water droplet (s) Symbolic Presentation on the Water Efficiency Lakel

用水效益级别

Water Efficiency Grade

全神水量

公升/沖廂 litres flush

低沖水量

公升/沖澗 litres/flush 3.0 Water Rush Volumn (Reduced

簽發日期:

18 June 2020 Date of Issue:





for Director of Water Supplies

上述水崩具額外節水功能,即:重用洗盥水作沖庫用途。



Test Report

Title: Testing of WC

Method: Health Technical Memorandum(HTM) 64 & BS EN 997: 2012 + A1: 2015

Report No.: J 25282A

3119-WT=TF3119 Completion: 13 Nov., 2020

Applicant (Information provided by client)

Name:

Address:

Sample (Information provided by client)

Description: Wall Hung WC Pan

Brand: American Standard

Model: 3119-WT

Body Marking:

American Standard

Manufacturer: LIXIL (Thailand) Public Company Limited

Origin: Thailand

Approved Signatory

Signature :

Name (title): Hing Kah Kuin (Engineer).

Date: 13 May 2022

Nutek Systems is a texting agency, accepted by the Water Supplies Department, for texting water supply

NUTEK

REPORT NO.: J 25282A

Summary

Test		Remark
1 Dimensions of WC Pan	CO SUE CAN	C
2 Static Load of Class 2 Products	CME SANIT	C C

Results (apply only to samples tested)

1 Dimensions of WC Pan

Health Technical Memorandum(HTM) 64

Variable	Measured	Required	Remark
Maxmium length of WC Pan	550	520-550	С
Maxmium height of WC Pan	Not applicable	475-480	Not applicable
Overall result	.0		С

The sample is a wall-hung WC Pan, the height relative to the ground is adjustable, thus not applicable

2 Static Load of Class 2 Products

BS EN 997: 2012 + A1: 2015 Cl. 5.7.4

ID	Variable	Unit	Measured	Required	Remark
	Force applied	kN	4.00	4.00 ± 0.05	С
1	Duration	h	1 .0	0 1	С
	Cracking or permanent deformation		No	No	С
all ros	rult		.0		(

Note:

Refer to Health Technical Memorandum(HTM) 64, a load of 140kg shall be sustained, this test result also applies to HTM 64 requirements

NUTEK SYSTEMS (HK) LIMITED
136F, Block A, Universal Industrial Centre, 23-25 Shan Mei Street, Fo Tan, New Territories, Hong Kong
78c: +Block 5758 | Fax - 6952 2692 0798 | Info@mutek.co | www.nutek.co

Page 2 of 4

NUTEK SYSTEMS (HK) LIMITED
13F, Block A, Universal Industrial Centre, 23-25 Shan Mei Street, Fo Tan, New Territories, Hong Kong
Tell. +892 2055 5736 | Fax = 582 2092 0798 | info@mutek.co | www.mutek.co

Page 1 of 4



General Note(s) Definitions: C - conformance N - no requirement NC - non-conformance R - remainder Organizations: WSD - Water Supplies Department (of Hong Kong) WHO - World Health Organization

REPORT NO.: J 25282A

NUTEK SYSTEMS (HK) LIMITED

13/F. Block A, Universal Indiadrial Centre, 23-25 Shan Mei Street, Fo Tan, New Territories, Hong Kong
Tel.: +652 2605 5736 | Fax: +652 2602 6798 | info@mutek.co | www.nutek.co

Page 3 of 4

NUTEK SYSTEMS (HK) LIMITED

13/F, Block A, Universal Industrial Centre, 23-25 Shan Mei Street, Fo Tan, New Territories, Hong Kong
Tel.: +852 2605 6736 | Fax: +852 2692 0736 | info@mutek.co | www.nutek.co

NUTEK

Page 4 of 4



Test Report



Title: Testing of WC Pan

Method: BS 3402: 1969

Report No.: J 25282B

Completion: 19 Nov., 2020 to 27 Nov., 2020

3119-WT=TF3119

Applicant (Information provided by client)

Name:

Address:

Sample (Information provided by client)

Description: Wall Hung WC Pan

Brand: AMERICAN STANDARD

Model: 3119-WT

Body Marking:

American Standard

Manufacturer: LIXIL (Thailand) Public Company Limited

Origin: Thailand

Approved Signatory

Name (title): Hing Kah Kuin (Engineer) Date: 13 May 2022

Nutek Systems is a testing agency, accepted by the Water Supplies Department, for testing water supply

Page 1 of 5



REPORT NO: J 25282B

Summary

Test	Remark
1 Visual Examination	C
2 Water Absorption	C W
3 Crazing	c of
4 Chemical Resistance Test	OUE CAN
5 Resistance to Staining and Burning	S°C

Results (apply only to samples tested)

1 Visual Examination

BS 3402: 1969 Cl. 5.1 & Table 1

Location	Blemish or defect	Maximum permitted	Remark
General	Wavy finish	None on all visible surfaces	С
Mr.	Warpage	Not more than 6mm	С
·	Discoloration	None on all visible surfaces	С
Flushing surface and norizontal face of rims of WC pans bidets and	Spots, blister and pinholes	A total of not over three; no grouping; for coloured appliances, blister and pinhole limited to one.	Maric
urinals	Bubbles and specks	Not over two in one pottery square; a total of not over four	С
×9.	Polishing marks	One only; none permitted for coloured fictures	С
Visible surfaces other than above	Spots, blisters and pinholes	A total of not over five; no grouping; for coloured appliances, no blisters are permitted and pinholes are limited to a total of two	С
July .	Bubbles and specks	Not over three in one pottery square; a total of not over ten	С
Overall result	100	0	C

2 Water Absorption

BS 3402: 1969 CL 6

ID	Weight (kg)		Absorption	Required	Remark
	Before Test	AfterTest	(%)		
Sample 1	115.9611	116.0766	0.10	2	С
Sample 2	115.888	116.0359	0.13	0.75% max.	С
Sample 3	122.0004	122.1591	0.13		С
Average			0.12	0.50% max.	С
Overall result					С

| NUTEK SYSTEMS (HK) LIMITED | 13/F, Block A, Universal Industrial Centre, 23-25 Shan Mei Street, Fo Tan, New Territories, Hong Kong | Tel.: +852 2805 5736 | Fax: +852 2892 0798 | info@rutek.co | www.mutek.co

Page 2 of 5

NUTEK SYSTEMS (HK) LIMITED

1 3/F Block A. Universal Industrial Centre, 23-25 Shan Mei Street, Fo Tan, New Terrhories, Hong Kong

78/L -1852 2605 5736 | Fax. 4852 2692 0798 | info@mutek.co | www.nutek.co



REPORT NO: J 25282B

3 Crazing

BS 3402: 1969 Cl. 7

ID	Variable		Unit	Measured	Required	Remark
201	Saturated s	team	MN/m ²	0.34	0.33 - 0.35	C
	Duration	65	h	10	10	C
1		Sample 1		No		75C
	Crazing	Sample 2		No	No	C
		Sample 3		No	0.50	С
Ourarall ra	e.ult				000	-

4 Chemical Resistance Test

BS 3402: 1969 Cl. 8

1
17
1

ID	Solution	Time (h)	Temperat- ure (°C)	Measured	Required	Remark
1	Acetic acid	16	100	No Loss		С
	Citric acid	16	100	No Loss		C
	Detergent	48	60	No Loss	No loss of reflectivity on glaze	С
AN Wale	Hydrochloric acid	48	20	No Loss		С
	Sodium hydroxide	0.5	60	No Loss		C
	Sodium stearate	48	60	No Loss		С
	Sulphuric acid	16 (100	No Loss		C
Overall res	ult	,0,				0

5 Resistance to Staining and Burning

BS 3402: 1969 Cl. 9

ID	Variable	Unit	Measured	Required	Remark
	Methylene blue	***	No Stain	Up.	С
	Sodium hypochlorite		No Stain	P. 1	С
1	Hydrogen peroxide		No Stain	No stain	С
	Amyl acetate		No Stain	remains	С
	lodine in ethanol		No Stain		C
2	Lighted cigarette		No Stain		С
erall re	sult				С

Page 3 of 5



Figure 1 - Sample

REPORT NO: J 25282B



Figure 2 - Body marking



NUTEK SYSTEMS (HK) LIMITED

13F, Block A, Universal Industrial Contre, 23-25 Shan Mel Street, Fo Tan, New Territories, Hong Kong
Tet.: +852 2605 5736 | Fax: +852 2692 9788 | into@nutek.co | www.nutek.co

Page 4 of 5

NUTEK SYSTEMS (HK) LIMITED

[13/F, Block A, Universal Industrial Centre, 23-25 Shan Mei Street, Fo Tan, New Territories, Hong Kang

Tel: +852 2605 5736 | Fax: +852 2692 0798 | info@rutek.co | www.nutek.co



REPORT NO: J 25282B

General Note(s)

Definitions:

C - conformance

N - no requirement

NC - non-conformance

R - remainder

Organizations:

WSD - Water Supplies Department (of Hong Kong)

WHO - World Health Organization

- End of report -

Page 5 of 5

NUTEK SYSTEMS (HK) LIMITED
13/F, Block A, Universal Industrial Centre, 23-25 Shan Mei Street, Fo Tan, New Territories, Hong Kong
TEL +852 2695 5736 | Fax - 582 2692 0798 | info@nutek.co | www.nutek.co

IMSL

INDUSTRIAL MICROBIOLOGICAL SERVICES LTD

STUDY REPORT: Determination of the Antibacterial Activity of a Ceramic Glaze Formulation against Escherichia coli and Staphylococcus aureus using ISO 22196: 2011.

CLIENT:

REPORT NO:

IMSL 2015/11/002.1B

DATED:

21st December 2015



Industrial Microbiological Services Ltd Registered in England No 3204423 Registered Office The Collicions Hall Onlind Road Reading Berkehire RG1 7NG

Study:

Determination of the Antibacterial Activity of a Ceramic Glaze Formulation against Escherichia coli and Staphylococcus aureus using ISO 22196: 2011.

Number:

IMSL 2015/11/002.1B

The above study was conducted in the laboratories of Industrial Microbiological Services Ltd at Pale Lane Harrley Wintney, Hants, RG278DH, UK. This report represents a true and accurate account of the results obtained.

Start Date

14th December 2015

Report Issued 21th December 2015

Kyle Allison

Operator



IMSI

INDUSTRIAL MICROBIOLOGICAL SERVICES LTD

CERTIFICATE OF ANALYSIS

CERTIFICATE NO.

1029047.1B

CUSTOMER

CUSTOMER REF.

SAMPLE DETAILS

DATE ANALYSED

DATE RECEIVED

14-Dec-15

Ceramic Tile METHOD: (Determination of Antibacterial Activity using Modifed ISO 22196)

15-Dec-15

DATE REPORTED

21-Dec-15

RESULTS (AS CFU CM -2)

E. coli E. coli	0 1.5E+04 1.5E+04	24 2.4E+05	-	<u> </u>
E. coli	-			
	1.5E+04	405.00		
		1.9E+05		200
E. coli	1.5E+04	6.0E+04	-	No-
E. coli	1.5E+04	2.6E+02	2.4	99.57%
aureus	1.5E+04	5.2E+03	- 3	٥٠ -
aureus	1.5E+04	7.3E+03	- 60%	
aureus	1.5E+04	3.8E+03	-,4,7	-
aureus	1.5E+04	1.6E+03	0.4	58.06%
			DO.	
	aureus aureus aureus	aureus 1.5E+04 aureus 1.5E+04 aureus 1.5E+04	aureus 1.5E+04 5.2E+03 aureus 1.5E+04 7.3E+03 aureus 1.5E+04 3.8E+03	aureus 1.5E+04 5.2E+03 - aureus 1.5E+04 7.3E+03 - aureus 1.5E+04 3.8E+03 -

The above data shows the difference in the population following contact with the surface of the Treated Sample for 24 hours at 35°C under a RH of > 95% relative to the population recovered from the Blank Tile.

NS = Poor survival on control supplied.

INDUSTRIAL MICROBIOLOGICAL SERVICE LTD

PALE LANE HARTLEY WINTNEY HANTS

RG27 8DH UK

PETER D ASKEW MANAGING DIRECTOR