



PROJECT		REF		REV	ITEM CODE	
LOCATION		DATE			PAGE	

**SANITARY WARE SPECIFICATION SHEET**

<p>Item Descriptions</p> <p>Model</p> <p>Finish</p> <p>Country or region origin</p> <p>Manufacturer</p> <p>Source</p> <p>Contact Tel/Fax</p> <p>E-mail</p> <p>Website</p>	<p>Neoperl (Germany) Water flow limiter at <b>4.8 l/min WELS Grade 1</b> ; Registration No.1F15-0014</p> <p>44.3051.000</p> <p>Plastic</p> <p>Germany &amp; UK</p> <p>Neoperl</p> <p>Acme Sanitary Ware Co. Ltd Mr. Eric Wong / Mr. Don Yuen</p> <p>(852) 2388-7171 / (852) 2710-8012</p> <p>acme@acmesanitary.com.hk</p> <p>www.acmesanitary.com.hk</p>	<p>Illustration/ Drawing</p>  
---	--	--

Note:

\* All information of the above is for the reference only. No prior notice is made if any changes.



自願參與用水效益標籤計劃- 節流器  
Voluntary Water Efficiency Labelling Scheme - Flow Controllers



茲證明  
This is to certify that

將下列節流器在本計劃內註冊：  
has registered the following flow controller under this scheme :

牌 子 / Brand	:	NEOPERL
型 號 / Model	:	44.3051.000
種 類 / Category	:	1
原 產 地 / Country or Region Origin	:	Germany & UK

在用水效益標籤上展示的標誌 <i>Symbolic Presentation on the Water Efficiency Label</i>	:	☾	滴水點 <i>Water droplet(s)</i>
用水效益級別 <i>Water Efficiency Grade</i>	:	1*	
耗水量 <i>Water Consumption</i>	:	4.8	公升/分鐘 <i>litres/minute</i>

\*Merited function: Constant flow operation

簽發日期:  
Date of Issue: 4 December 2015

 水務署  
Water Supplies Department



水務署署長(周世威代行)  
for Director of Water Supplies




MR05 PL-TT 5.0L  
58.6784.1

**Data Sheet**

Production Batch	136918
Date	27.03.15.

	SIGNED	DATE
TESTED		
QC		

[bar]	1.2	1.5	2.5	3.5	5.0	6.0						[°C]	
[l/min]	5.06	5.38	5.20	4.98	5.24	5.28						No. 1	20.00
[l/min]	5.09	5.45	4.96	4.87	5.11	5.10						No. 2	19.93
[l/min]	4.97	5.33	4.86	4.82	5.03	5.06						No. 3	19.97
[l/min]	5.01	5.33	4.88	4.89	5.13	5.17						No. 4	20.02
[l/min]	5.21	5.57	4.96	4.92	5.16	5.18						No. 5	20.03
[l/min]	4.94	5.30	5.08	4.87	5.07	5.09						No. 6	19.95
[l/min]	5.15	5.51	5.37	5.08	5.35	5.39						No. 7	20.00
[l/min]	4.98	5.30	5.27	4.97	5.24	5.27						No. 8	20.03
[l/min]												No. 9	
[l/min]												No. 10	
[l/min]	5.05	5.40	5.07	4.92	5.17	5.19						Mean	
	0.09	0.10	0.18	0.08	0.10	0.11						Std.-Dev.	

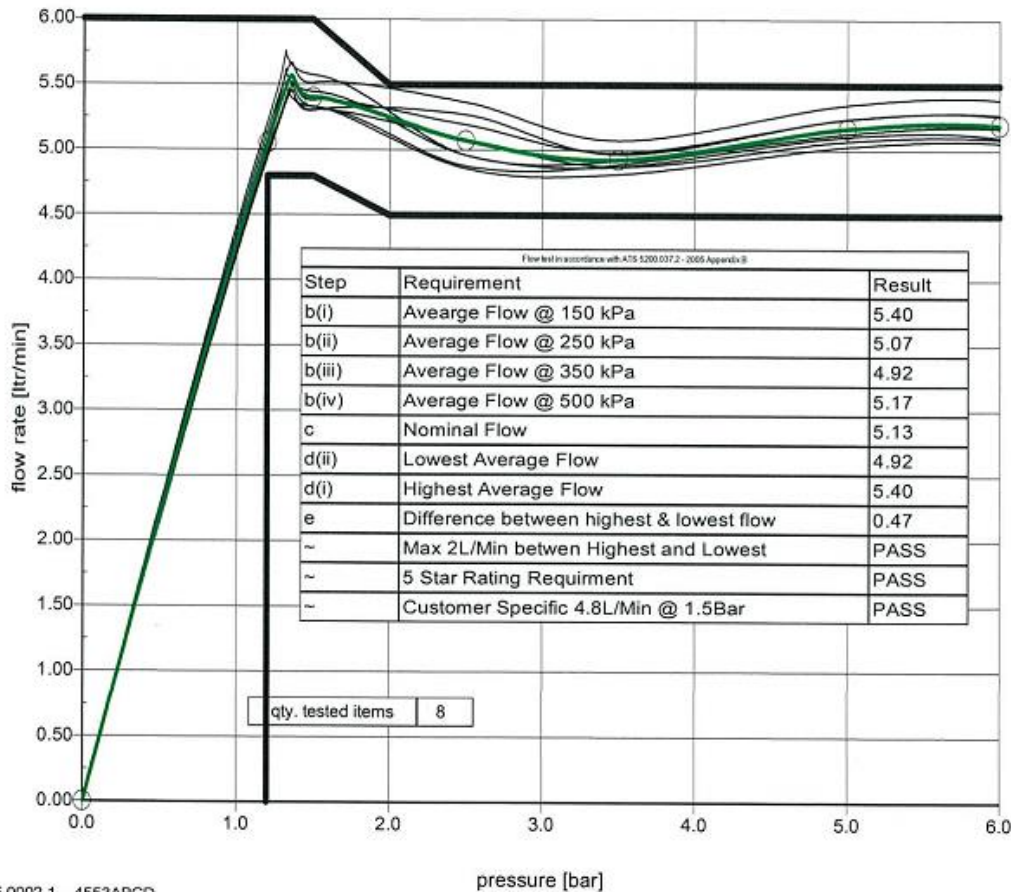

55.0002.1\_4553ABCD

27.03.15

270315\_1S\_12TJ

UK-JB  
CN1280



Waterworks Department

入境事務大樓48樓  
48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (4) in WSD 3321/2021 T/J(129/2021)  
Our ref.  
來函檔號 :  
Your ref.


電話 :  
Tel.  
傳真 : 2824 0578  
Fax.

12 March 2021

### Approval of "NEOPERL" Flow Controller (General Acceptance No. C20210249)

Your letters both ref. 024-rkre dated 31 December 2020 and 16 February 2021 refer.

Having considered the test report ref. J25810 issued on 18 November 2020 by Nutek Systems (HK) Ltd., this Authority accepts that the fitting described below complies with, and its use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

**Name of Manufacturer:** Neoperl GmbH  
**Country of Origin:** Germany  
**Brand:** Neoperl  
**Details of Fitting:** Flow controller  
**Model:** 44.3051.000  
**Body Markings:**   
**Expiry Date:** 10 November 2025



This Authority hereby permits the use of the above fitting in fresh water plumbing systems subject to full adherence to Waterworks installation requirements.

A condition of this acceptance is that the fitting to be installed shall be replicas of the sample as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fitting installed fails to meet that of the approved sample or if the fitting is found to be unsuitable for use in fresh water plumbing systems.

For the use of the fitting in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fitting by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,



(Roger WONG)

for Director of Water Supplies

Encl.

c.c.    WSD 3321/1/82    ] - without catalogue  
         ME/MC            ] - with soft copy only