



Acme Sanitary Ware Co. Ltd.

1/F, Acme Building, 22-28 Nanking Street, Kowloon, Hong Kong


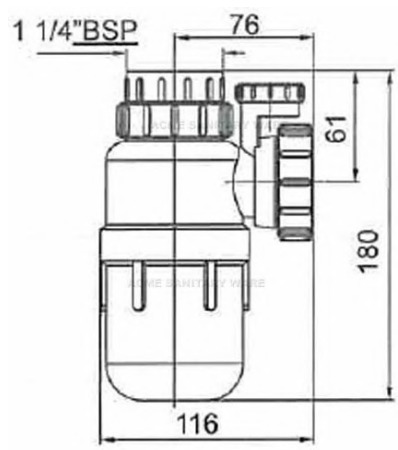
Tel: 2388 7171 Fax: 2710 8012

Email: acme@acmesanitary.com.hk

Website: www.acmesanitary.com.hk

PROJECT		REF		REV	ITEM CODE	
LOCATION		DATE			PAGE	

SANITARY WARE SPECIFICATION SHEET

<p>Item Descriptions</p> <p>Model</p> <p>Color</p> <p>Material</p> <p>Manufacturer</p> <p>Supplier</p> <p>Contact Tel/Fax</p> <p>E-mail</p> <p>Website</p>	<p>Diethelm (PRC) 32mm plastic anti-syphon bottle P-trap with one way valve disk of stainless steel complied with clause C1.2.3 of general specification for Drainage installation by ASD (edition 2017); BS3943:1979 & BS6280:1982; test report J2558A</p> <p>1010</p> <p>White</p> <p>Plastic</p> <p>Diethelm (PRC)</p> <p>Acme Sanitary Ware Co. Ltd Mr. Eric Wong/ Mr. Don Yuen</p> <p>(852) 2388-7171 / (852) 2710-8012</p> <p>acme@acmesanitary.com.hk</p> <p>www.acmesanitary.com.hk</p>	<p>Illustration/ Drawing</p>  
--	--	---

Note:

* All information of the above is for the reference only. No prior notice is made if any changes.



NUTEK SYSTEMS, LTD.

Unit F, 7/F., Universal Ind. Ctr.
19-21 Shan Mei Street,
Fo Tan, Shatin, N.T., Hong Kong.
Tel: (852) 2605 5736 Fax: (852) 2692 0798

TEST REPORT

TITLE : Testing of Waste Trap
OUR REFERENCE : J2558A
DESCRIPTION OF SAMPLE : 32mm Plastic Anti-siphon Bottle Trap
SAMPLE SUBMITTED BY :

MODEL : 1010
BRAND : DIETHELM
BODY MARKING : DIETHELM SINGAPORE
 MODEL NO. 1010
METHOD OF TESTS : BS3943 : 1979 ; BS6280 : 1982
PERIOD OF TESTS : 13th to 24th March 1995



RESULTS : - 1. DIMENSIONS

	Sample	BS Requirement
Nominal Size (mm)	32	/
Minimum Cross-sectional area of waterway (mm ²)	994.9	640
Depth of Water Seal (mm)	101.8	38 min. or 75 min.
Internal Diameter of Inlet Tubing (mm)	35.4	/
Internal Diameter of Outlet Tubing (mm)	35.5	/

2. HYDRAULIC PRESSURE TEST

	Test Pressure (kPa)	Duration (sec)	Remark
Sample	40	10	Pass
BS Requirement	40	10	/

3. WATER SEAL TEST

	Test Pressure (Pa)	Duration (sec)	Remark
Sample	690	10	Pass
BS Requirement	690	10	/



NUTEK SYSTEMS, LTD.

Unit F, 7/F., Universal Industrial Centre,
19-21 Shan Mei Street,
Fo Tan, Shatin, N.T., Hong Kong
Tel: 2605 5736 Fax: 2692 0798

TEST REPORT

OUR REFERENCE NO. J2558A (P.2)

4. FLOW OF WATER TEST

	Water flow rate (litre/min)	Remark
Sample	61.7	Pass
BS Requirement	40 min.	/



5. INTERNAL CLEARANCE TEST



Pass ; the trap is capable of accommodating the passage of a steel ball of diameter 10mm, when tested by passing the ball right through from inlet to outlet.

6. RESIDUAL STRESS TEST

The trap was immersed in boiling solution of 0.2% sodium alkyl aryl sulphonate detergent with 0.5% margarine. After 30 minutes, the trap was removed and allowed to cool. It showed neither cracking nor degeneration, and the function of maintaining the water seal is not affected.

Remark : Pass

7. BACKSIPHONAGE TEST (BS6280)

	Test pressure, absolute (bar)	Duration (sec)	Amount of water collected in the water trap (ml)	Remark
Sample	0.5	5	0	Pass
BS Requirement	0.5	5	0	/

8. SUMMARY OF RESULTS (apply only to the samples tested)

Dimension - Satisfactory
 Hydraulic Pressure Test - Satisfactory
 Water Seal Test - Satisfactory
 Flow of Water Test - Satisfactory
 Internal Clearance Test - Satisfactory
 Residual Stress Test - Satisfactory

DATE : 24th March 1995

CERTIFIED BY : E. A. Bruges

Nutek Systems is a testing agency,
approved by the Water Authority and
Government Supplies Department, for
testing water supply fittings.

E.A. Bruges
BSc PhD CEng FIMarE
FIMechE FHKIE MASME
MASHRAE

Director & General Manager



NUTEK SYSTEMS, LTD.

Unit F, 7/F., Universal Industrial Centre,
19-21 Shan Mei Street,
Fo Tan, Shatin, N.T., Hong Kong
Tel: 2805 5736 Fax: 2892 0798

TEST REPORT

OUR REFERENCE NO. J2558A (P.3)

Appendix -- A Sketch of 32mm Plastic Anti-siphon Bottle Trap

