

## Acme Sanitary Ware Co. Ltd.

1/F, Acme Building, 22-28 Nanking Street, Kowloon, Hong Kong Tel: 2388 7171 Fax: 2710 8012 Email: acme@acmesanitary.com.hkSince 1949 Website: www.acmesanitary.com.hk



PROJECT	REF	REV	ITEM CODE	
LOCATION	DATE		PAGE	

#### SANITARY WARE SPECIFICATION SHEET

Item Descriptions INAX (Japan) Chrome plated deck

mounted thermostatic sensor mixer for cold & hot water in DC operated; bulit-in flow controller A-8187; hydro generator power; Nominal flow rate 2.9L/min in WELS Grade 1; Registration No. TM 20-

0102

Dimensions Height: 137mm

Model AM-200TC

Finish Chrome Plated

Manufacturer Inax (Japan)

Country of Origin Japan


Source Acme Sanitary Ware Co. Ltd

Mr. Eric Wong/ Mr. Don Yuen

Contact Tel/Fax (852) 2388-7171 / (852) 2710-8012


E-mail acme@acmesanitary.com.hk Website www.acmesanitary.com.hk

Dynamic flow pressure (kPa)	50	150	250	350	500
Flow rate (1/min)	1.60	2.80	2.90	2.95	2.95

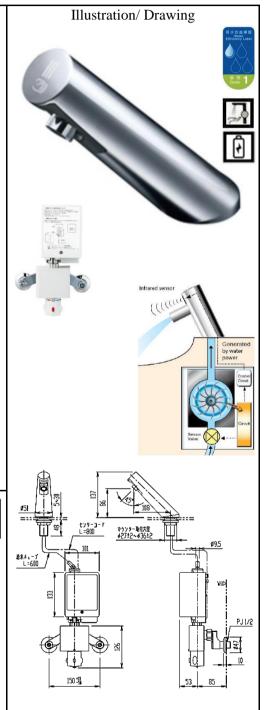





### 単水栓タイプ

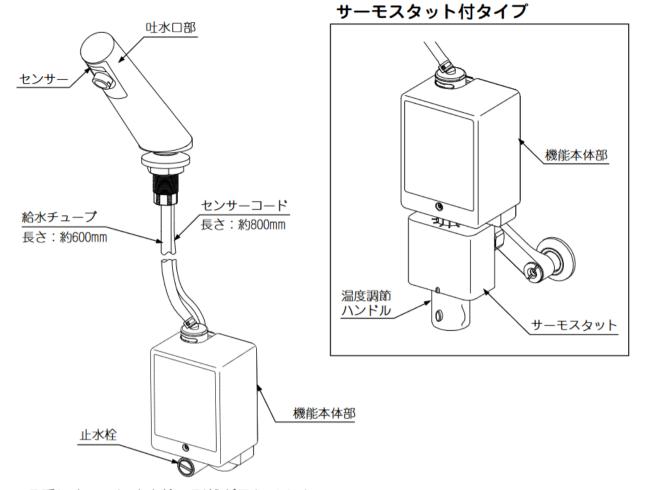



※品番によっては止水栓の形状が異なります。

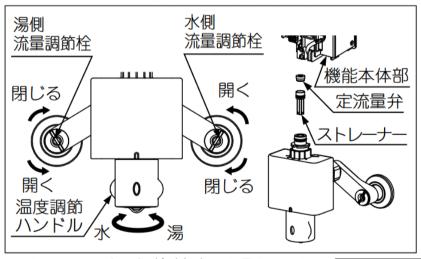





※センサーは赤外線を透過してしまうガラスなどでできたコップや花瓶は感知できません。また、ステンレス製およびメッキを施したコップなどは感知しないことがあります。感知範囲に手をかざしてご使用ください。

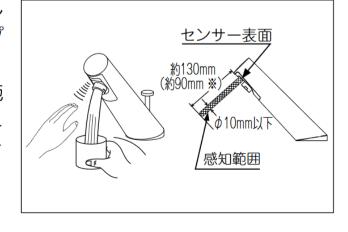


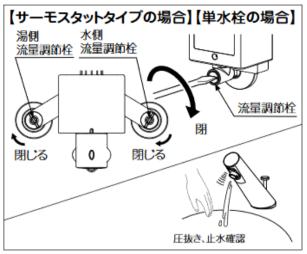


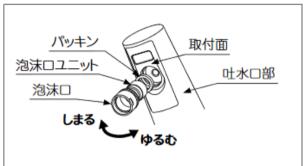


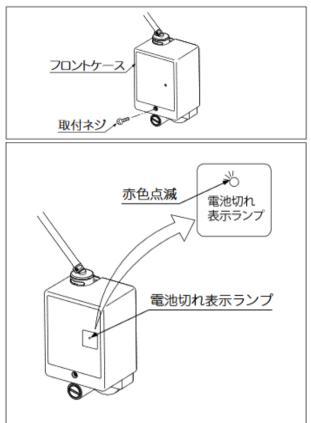



# 専用リチウム電池(品番: A-4305)の寿命と交換について

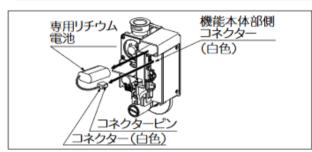


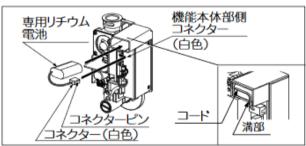


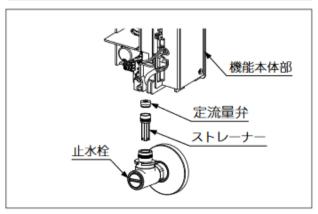

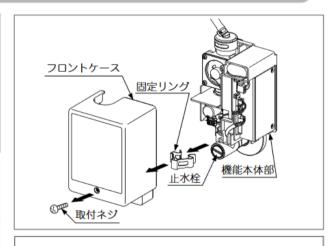

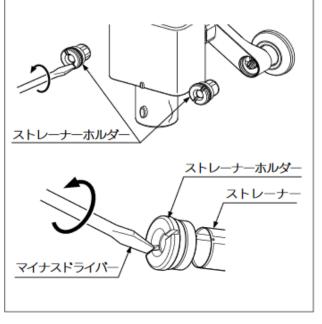

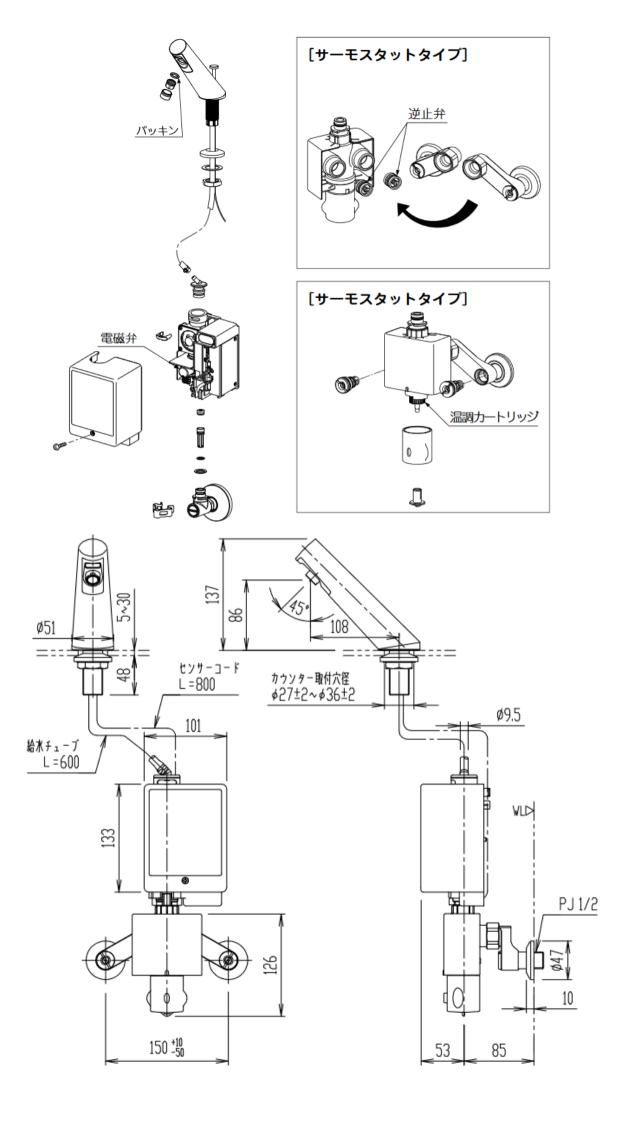

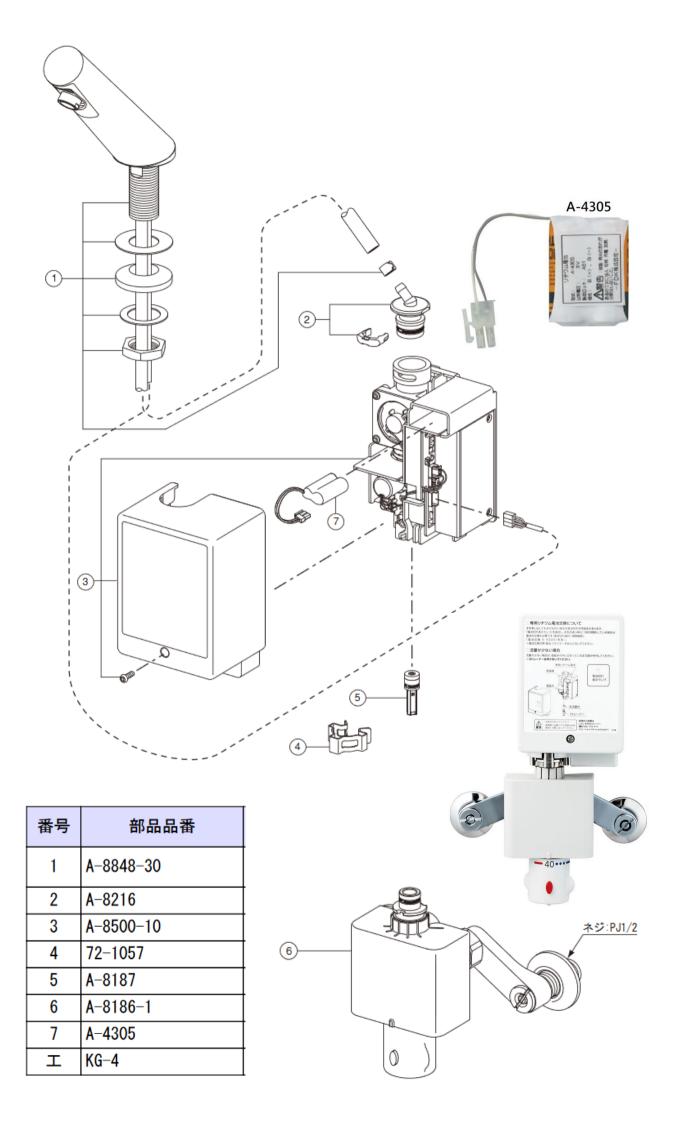

TM 20-0102



## 自願參與用水效益標籤計劃 - 水龍頭 Voluntary Water Efficiency Labelling Scheme - Water Taps



茲證明 This is to certify that

### 將下列水龍頭在本計劃內註冊: has registered the following water tap under this scheme:

牌 子 / Brand

: LIXIL INAX

型 號 / Model

AM-200TC + A-8187

種 類 / Type

Mixing

原產地 / Country or Region Origin

Japan (Mixer & Flow Controller)

在用水效益標籤上展示的標誌

Symbolic Presentation on the Water Efficiency Label

滴水點

Water droplet(s)

用水效益級別

Water Efficiency Grade

: 1

with additional merit\*

耗水量

Water Consumption

2.9

公升/分鐘 litres/minute

"with additional merit of "Automatic closing mechanism"

簽發日期: Date of Issue:

18 June 2020

水務署 Water Supplies Department



水務署署長(張業駒代行) for Director of Water Supplies





48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 Our ref. 來函檔號

Your ref.

(2) in WSD 3321/18 Pt.1 T/J(1310)

電話

Tel.

傳真 C

2824 0578

4 January 2019

## Approval of "LIXIL INAX" Sensor Mixer (General Acceptance No. C20190017)

Your letter ref. WRC/2008 dated 23 November 2018 refers.

Having considered the test reports ref. J23148A and J21657r1 issued on 16 November 2018 and 20 April 2018 by Nutek Systems (HK) Ltd., this Authority accepts that the fitting described below complies with, and its use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer:

LIXIL Corporation

Country of Origin:

Japan

Brand:

LIXIL INAX

Details of Fitting:

1/2" Electronic sensor basin mixer with 1 no. of rubber

hose

Model:

AM-200TC

**Body Markings:** 

LIXIL

**Expiry Date:** 

28 August 2022

(for mixer + hose)





This Authority hereby permits the use of the above fitting in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"A stop cock or gate valve must be installed at the upstream of the fitting for manual isolation of water supply."

"The main voltage operated sensor valve should comply with the electricity safety regulation for applications in bathroom, toilet etc." AND

"The cold water supply to the fitting shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply."

A condition of this acceptance is that the fitting to be installed shall be replicas of the sample as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fitting installed fails to meet that of the approved sample or if the fitting is found to be unsuitable for use in fresh water plumbing systems.

This acceptance is only applicable to the main body of the fitting, unless other specified.

For the use of the fitting in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fitting by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,

(CHAN Chung-kun)

for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82 ] - without catalogue ME/MC ] - with soft copy only