




**Acme Sanitary Ware Co Ltd**


Acme Building, 22-28 Nanking Street, Kowloon, Hong Kong
 Tel: 2388 7171 Fax: 2710 8012
 E-mail: acme@acmesanitary.com.hk
 Website: www.acmesanitaryware.com.hk

American Standard

PROJECT		REF		REV	ITEM CODE	
LOCATION		DATE			PAGE	

SANITARY WARE SPECIFICATION SHEET

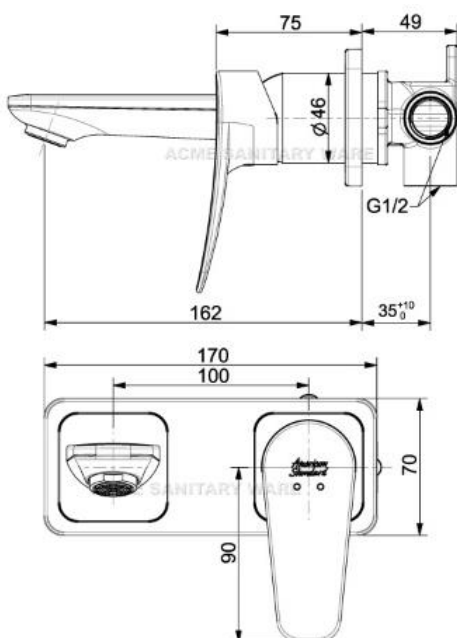Item Descriptions	American Standard (PRC) "Milano" Chrome plated wall mounted basin mixer; Nominal flow rate 4.7L/min in WELS Grade 1 ; Registration No. TM18-0264	<div>Illustration/ Drawing</div> <div></div> <div></div> <div></div>
Dimensions	L162 x W170 x H70 mm	
Model	CF-0904.104.50 (Mixer) 40.0056.000 (Aerator)	
Finish	Chrome Plated	
Manufacturer	American Standard (PRC)	
Source	Acme Sanitary Ware Co. Ltd Mr. Eric Wong/ Mr. Don Yuen	
Contact Tel/Fax	(852) 2388-7171 / (852) 2710-8012	
E-mail	acme@acmesanitary.com.hk	
Website	www.acmesanitary.com.hk	

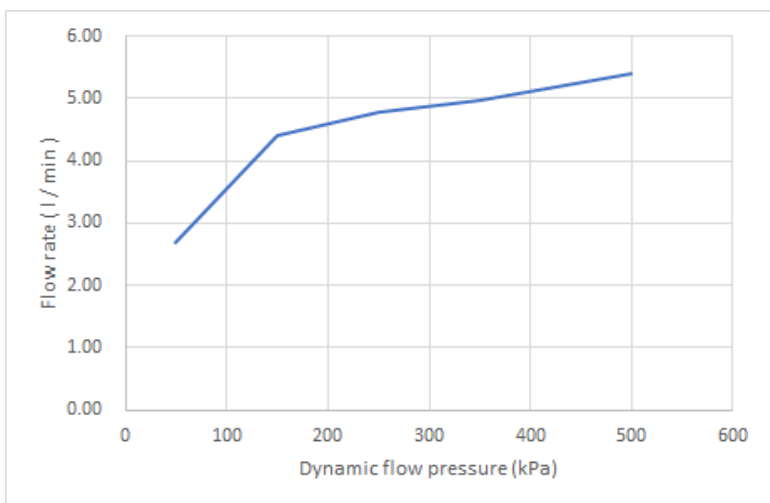

Dynamic flow pressure (kPa)	50	150	250	350	500
Flow rate (l/min)	2.70	4.40	4.78	4.98	5.40

Note: Same product but different model no:

CF-0904.104.50.1 (PRC) or FFAS0904-104500BC0

* All information of the above is for the reference only. No prior notice is made if any changes.

註冊號碼 (Registration No.): TM 18-0264




自願參與用水效益標籤計劃 - 水龍頭
Voluntary Water Efficiency Labelling Scheme - Water Taps



茲證明
This is to certify that

將下列水龍頭在本計劃內註冊：
has registered the following water tap under this scheme :

牌 子 / Brand	:	American Standard
型 號 / Model	:	CF-0904.10X.50 + 40.0056.000
種 類 / Type	:	Mixing
原產地 / Country or Region Origin	:	China

在用水效益標籤上展示的標誌 <i>Symbolic Presentation on the Water Efficiency Label</i>	:		滴水點 <i>Water droplet(s)</i>
用水效益級別 <i>Water Efficiency Grade</i>	:	1	
耗水量 <i>Water Consumption</i>	:	4.7	公升/分鐘 <i>litres/minute</i>

簽發日期: 16 October 2018
Date of Issue:



水務署
Water Supplies Department



水務署署長(鍾兆榮代行)
for Director of Water Supplies



水務署
Water Supply



總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (4) in WSD 3321/18 Pt.1 T/J(668)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

19 September 2018



Approval of "AMERICAN STANDARD" Basin Mixers (General Acceptance No. C20180631)

Your letters ref. WRC/1819 dated 19 June 2018 and ref. C-WSD/0462 dated 20 August 2018 refer.

Having considered the test report ref. J22981Ar1 issued on 9 August 2018 by Nutek Systems (HK) Ltd., this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: American Standard

Country of Origin: China

Brand: American Standard

Details of Fitting: 1/2" Single lever wall mounted basin mixer

Model: CF-0904.10X.50
WF-0904.10X.50
(where the digit "X" denotes the code of handle)

Body Markings: *American Standard*



Expiry Date: 24 May 2023

This Authority hereby permits the use of the above fittings in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"The cold water supply to the fittings shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water plumbing systems.

This acceptance is only applicable to the main body of the fittings, unless other specified.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,



(CHAN Chung-kun)

for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only