





PROJECT		REF		REV	ITEM CODE	
LOCATION		DATE			PAGE	

**SANITARY WARE SPECIFICATION SHEET**


<p>Item Descriptions</p> <p>Dimensions</p> <p>Model</p> <p>Finish</p> <p>Manufacturer</p> <p>Source</p> <p>Contact Tel/Fax</p> <p>E-mail</p> <p>Website</p>	<p>EMCA (PRC) Ø32 mm 2U type stainless steel fixed urinal grab bar ; GB 175-2007 ; capable of carrying a <b>static loading test 150kg</b> ; test report J24248r1 ; complied with Barrier Free Access 2008</p> <p>L900 x W551 x H600 mm</p> <p>EM7030.013-900</p> <p>Satin Stainless Steel</p> <p>EMCA (PRC)</p> <p>Acme Sanitary Ware Co. Ltd Mr. Eric Wong/ Mr. Wilson Hung</p> <p>(852) 2388-7171 / (852) 2710-8012</p> <p>acme@acmesanitary.com.hk</p> <p>www.acmesanitary.com.hk</p>	<p>Illustration/ Drawing</p>
<p>Plastic Expansion Tube &amp; Screws (18pcs)</p>		

**Note:**

*\* All information of the above is for the reference only. No prior notice is made if any changes.*

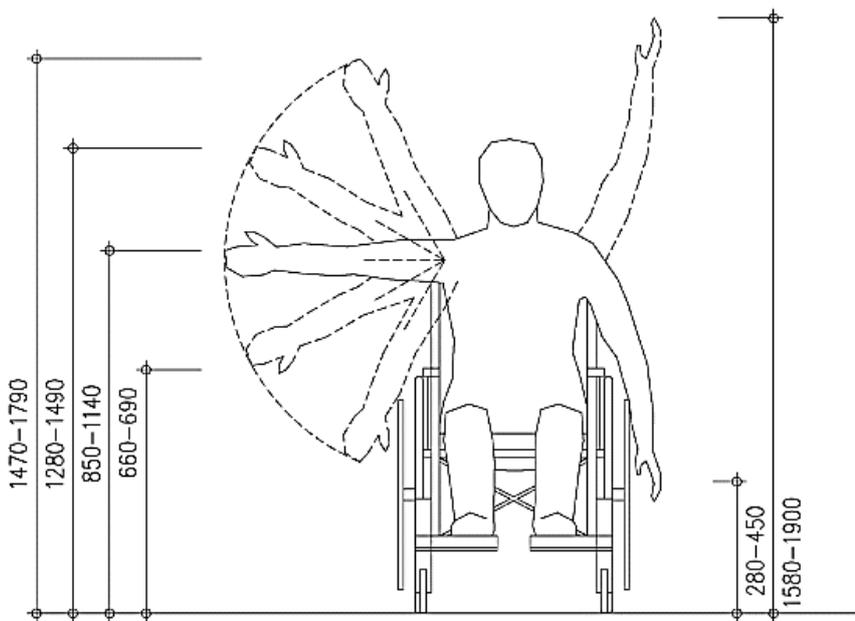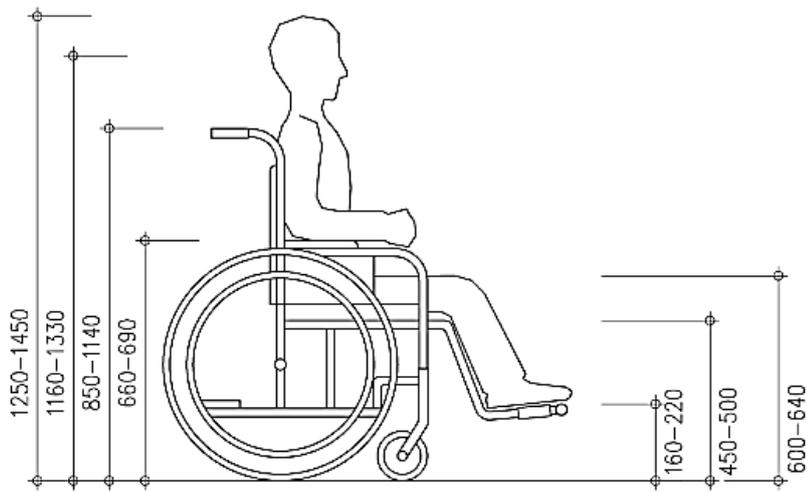

Extracted from Design Manual  
- Barrier Free Access 2008  
(Amendments in June 2019)

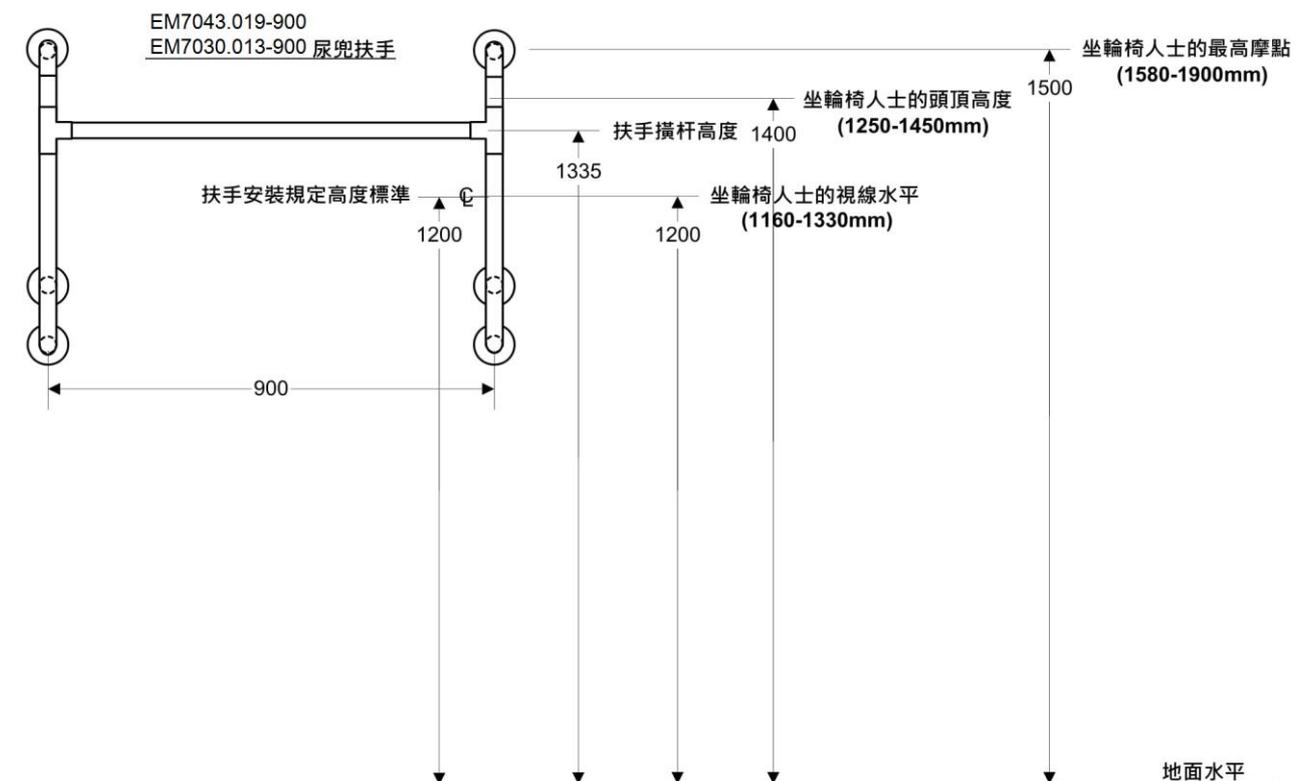

The above information is for reference only.



# Nutek Systems

Nutek Systems Limited, Block A, Universal Industrial Centre, 23-25 Shan Mei Street, FO TAN, N.T., HONG KONG  
Tel: +852 2619 9200 Fax: +852 2619 9209 Email: info@nuteksystems.com Website: www.nuteksystems.com

## Test Report

TITLE : Loading Test

REPORT NO. : J 24248r1  
(This report is issued to supersede the one of ref. J 24248)

DESCRIPTION OF SAMPLE<sup>1</sup> : S.S Fixed grab bar for urinal

SAMPLE SUBMITTED BY<sup>1</sup> : Acme Sanitary Ware Co., Ltd.  
1/F, Acme Building,  
22-28 Nanking Street  
Yau Ma Tei, Kowloon  
Hong Kong

COUNTRY OF ORIGIN<sup>1</sup> : PRC

BRAND<sup>1</sup> : EMCA

MODEL<sup>1</sup> : EM7030.013-900

BODY MARKING : /

METHOD OF TESTS : Loading test

PERIOD OF TESTS : 06 Jun., 2019

<sup>1</sup> – Information provided by client


RESULTS: (apply only to the sample tested)

### 1. LOADING TEST

The sample was installed onto a concrete wall in its normal application (cement to GB 175-2007). A test load was applied to the mid point of the sample which was then examined for any signs of damage.

ID	Weight/ downward load (kg)	Test duration (min)	Break/failure/ deflection/crack
Sample	150	30	Nil

Remark: Pass

Date: 22 Jul., 2019 Authorized signature: 

Nutek Systems is a testing agency, accepted by the Water Supplies Department, for testing water supply fittings.

**NG DICK TIK LUN**  
(Test Engineer)