


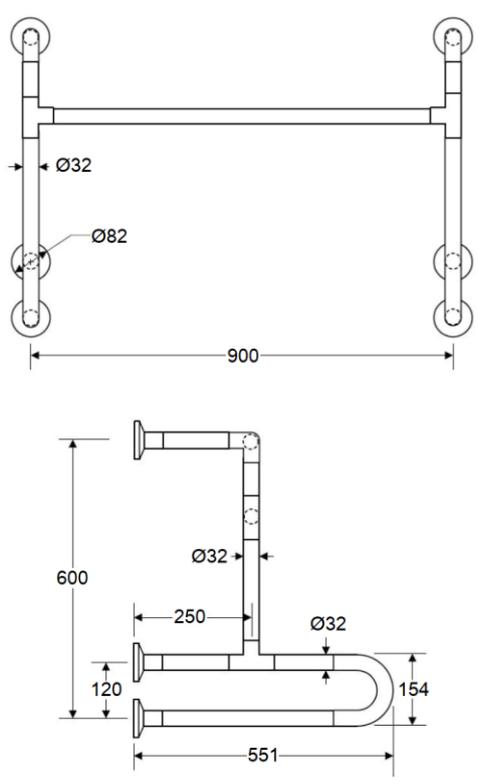



| | | | | | | |
|----------|--|------|--|-----|-----------|--|
| PROJECT | | REF | | REV | ITEM CODE | |
| LOCATION | | DATE | | | PAGE | |

SANITARY WARE SPECIFICATION SHEET


| | | |
|-------------------|--|--|
| Item Descriptions | EMCA (PRC) Ø32 mm 2U type stainless steel fixed urinal grab bar ; GB 175-2007 ; capable of carrying a static loading test 150kg ; test report J24248r1 ; complied with Barrier Free Access 2008 | <p>Illustration/ Drawing</p>   |
| Dimensions | L900 x W551 x H600 mm | |
| Model | EM7030.013-900 | |
| Finish | Satin Stainless Steel | |
| Manufacturer | EMCA (PRC) | |
| Source | Acme Sanitary Ware Co. Ltd Mr. Eric Wong/ Mr. Don Yuen | |
| Contact Tel/Fax | (852) 2388-7171 / (852) 2710-8012 | |
| E-mail | acme@acmesanitary.com.hk | |
| Website | www.acmesanitary.com.hk | |

Note:

* All information of the above is for the reference only. No prior notice is made if any changes.

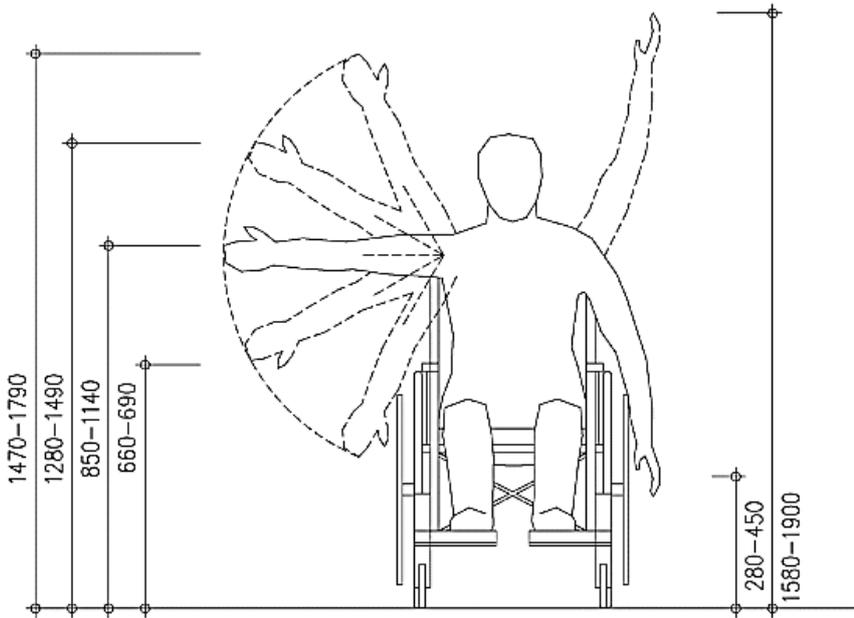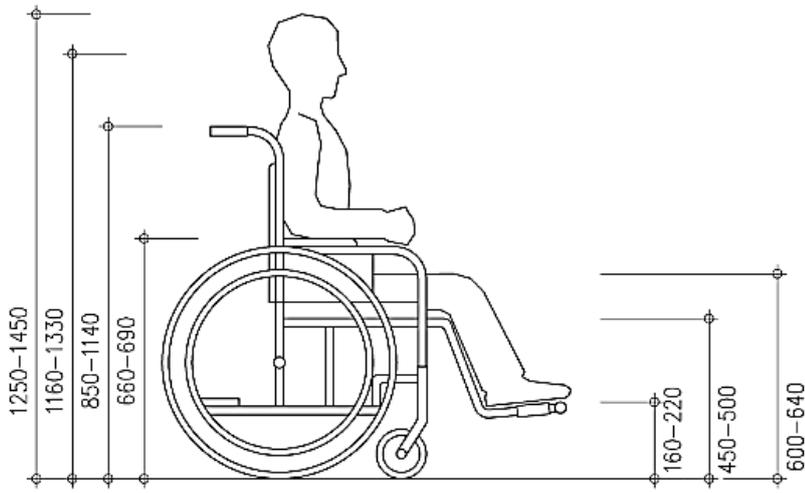

Extracted from Design Manual
- Barrier Free Access 2008
(Amendments in June 2019)

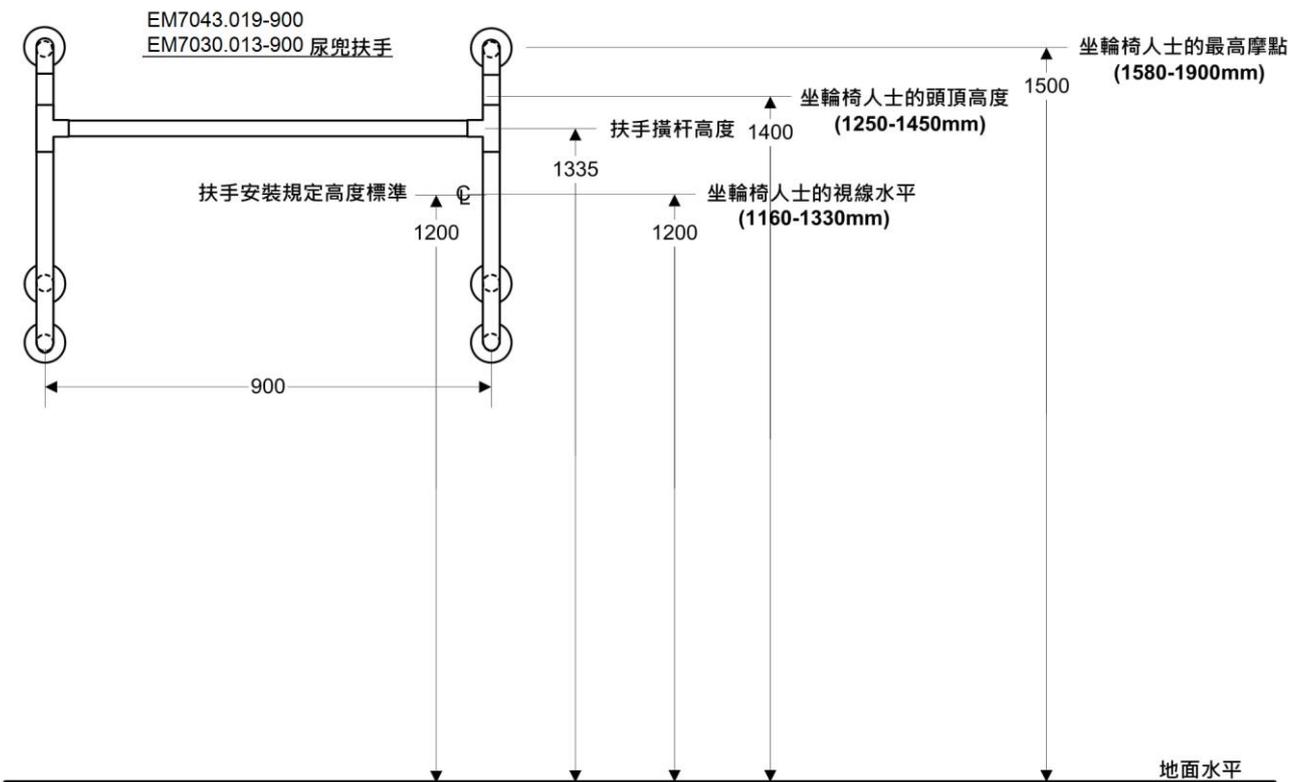

The above information is for reference only.



Nutek Systems

Nutek Systems Limited, Block A, Universal Industrial Centre, 23-25 Shan Mei Street, FO TAN, N.T., HONG KONG
Tel: +852 2619 9200 Fax: +852 2619 9209 Email: info@nuteksystems.com Website: www.nuteksystems.com

Test Report

TITLE : Loading Test

REPORT NO. : J 24248r1
(This report is issued to supersede the one of ref. J 24248)

DESCRIPTION OF SAMPLE¹ : S.S Fixed grab bar for urinal

SAMPLE SUBMITTED BY¹ : Acme Sanitary Ware Co., Ltd.
1/F, Acme Building,
22-28 Nanking Street
Yau Ma Tei, Kowloon
Hong Kong

COUNTRY OF ORIGIN¹ : PRC

BRAND¹ : EMCA

MODEL¹ : EM7030.013-900

BODY MARKING : /

METHOD OF TESTS : Loading test

PERIOD OF TESTS : 06 Jun., 2019

¹ – Information provided by client

RESULTS: (apply only to the sample tested)

1. LOADING TEST

The sample was installed onto a concrete wall in its normal application (cement to GB 175-2007). A test load was applied to the mid point of the sample which was then examined for any signs of damage.

| ID | Weight/ downward load (kg) | Test duration (min) | Break/failure/ deflection/crack |
|--------|----------------------------|---------------------|---------------------------------|
| Sample | 150 | 30 | Nil |

Remark: Pass

Date: 22 Jul., 2019 Authorized signature: NG Dick Tik Lun

Nutek Systems is a testing agency, accepted by the Water Supplies Department, for testing water supply fittings.

NG DICK TIK LUN
(Test Engineer)