


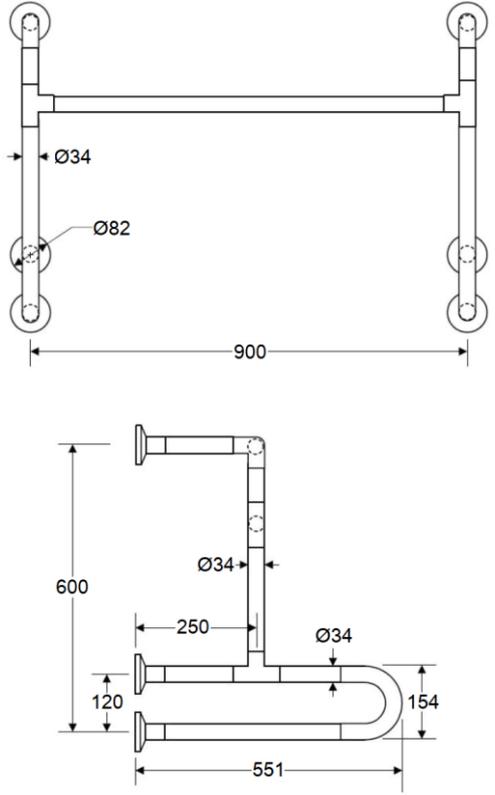



PROJECT		REF		REV	ITEM CODE	
LOCATION		DATE			PAGE	

SANITARY WARE SPECIFICATION SHEET


<p>Item Descriptions</p> <p>Dimensions</p> <p>Model</p> <p>Material / Color</p> <p>Manufacturer</p> <p>Source</p> <p>Contact Tel/Fax</p> <p>E-mail</p> <p>Website</p>	<p>EMCA (Taiwan) Ø34 mm 2U type ABS coated aluminium urinal grab bar ; GB 175-2007 ; capable of carrying a static loading test 150kg ; test report J24249r1 ; complied with Barrier Free Access 2008</p> <p>L900 x W551 x H600 mm</p> <p>EM7043.019-900</p> <p>ABS coated aluminium / White</p> <p>EMCA (Taiwan)</p> <p>Acme Sanitary Ware Co. Ltd Mr. Eric Wong/ Mr. Wilson Hung</p> <p>(852) 2388-7171 / (852) 2710-8012 acme@acmesanitary.com.hk www.acmesanitary.com.hk</p>	<p align="center">Illustration/ Drawing</p>  
	 <p align="center">Plastic Expansion Tube & Screws (18pcs)</p>  <p>The rail was smooth ABS tube with ovally knobbles impressed on surface offers better grip for wet hands or damp conditions.</p>	

Note:

* All information of the above is for the reference only. No prior notice is made if any changes.

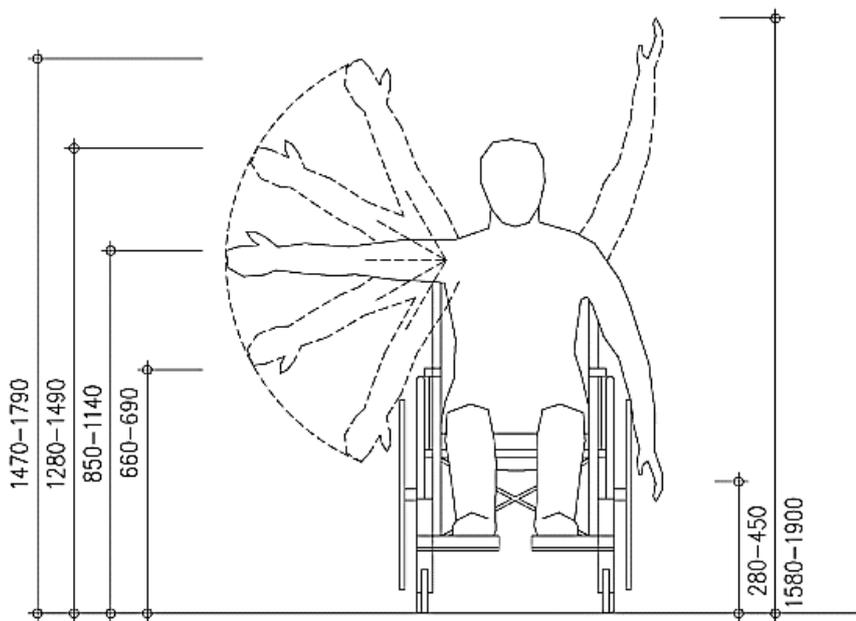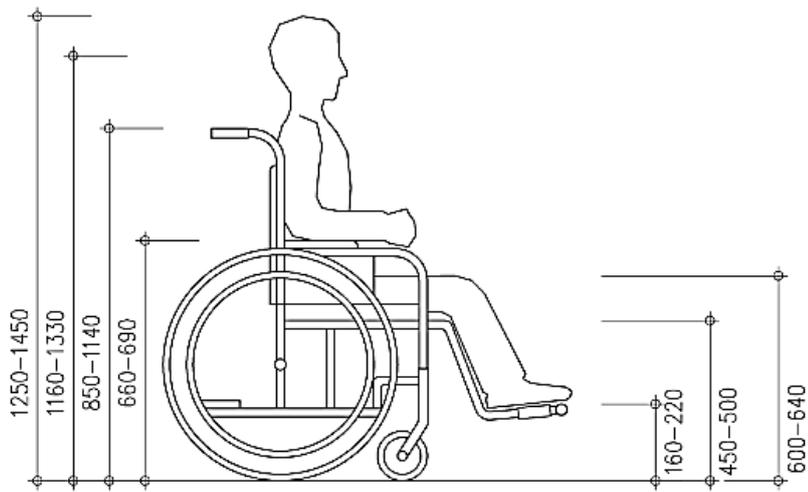

Extracted from Design Manual
- Barrier Free Access 2008
(Amendments in June 2019)

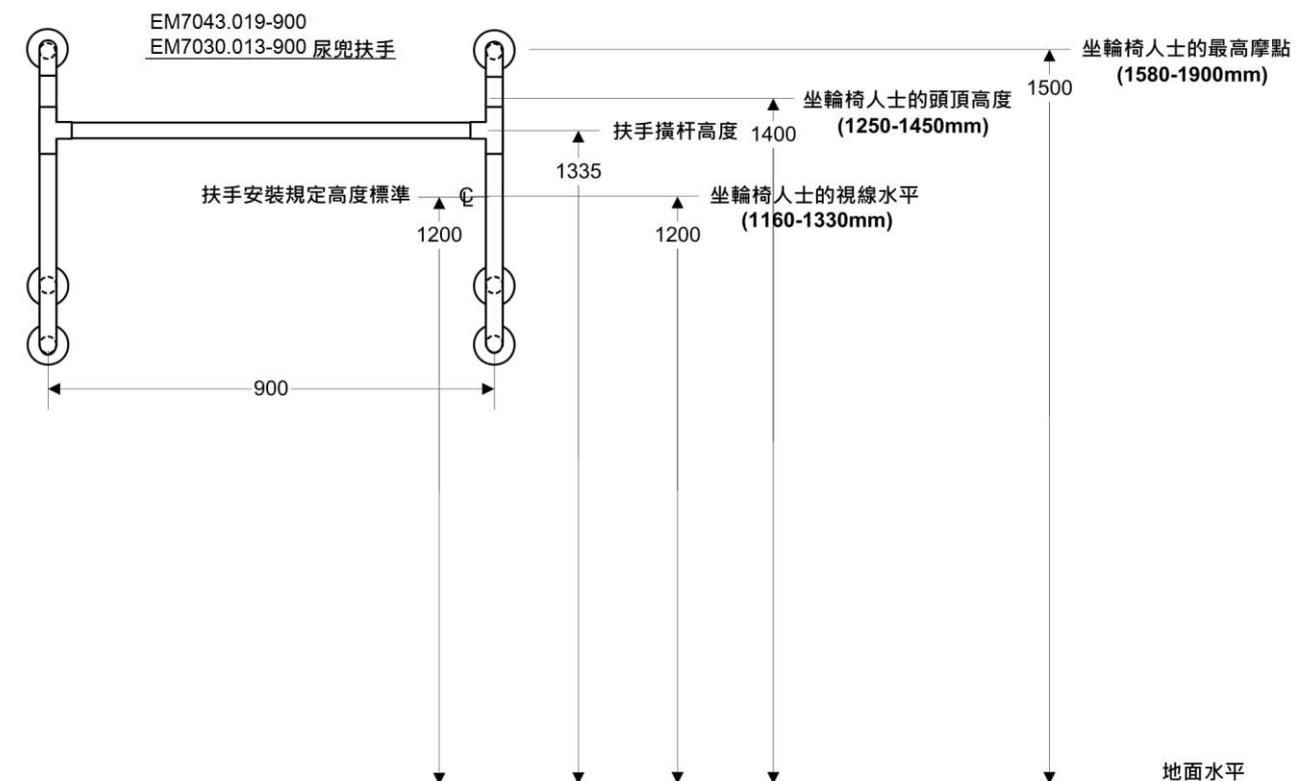

The above information is for reference only.



Nutek Systems
Tel: +852 2802 9696



Nutek Systems

A, Universal Industrial Centre, 23-25 Shan Mei Street, FO TAN, N.T., HONG KONG
info@nuteksystems.com www.nuteksystems.com

Test Report

TITLE : Loading Test

REPORT NO. : J 24249r1
(This test report is issued to supersede the one of ref. J 24249)

DESCRIPTION OF SAMPLE¹ : Fixed grab bar ABS coated aluminium for urinal

SAMPLE SUBMITTED BY¹ : Acme Sanitary Ware Co., Ltd.
1/F, Acme Building,
22-28 Nanking Street
Yau Ma Tei, Kowloon
Hong Kong

COUNTRY OF ORIGIN¹ : Taiwan

BRAND¹ : EMCA

MODEL¹ : EM7043.019-900

BODY MARKING : /

METHOD OF TESTS : Loading test

PERIOD OF TESTS : 11 May, 2019

¹ - Information provided by client

RESULTS: (apply only to the sample tested)

1. LOADING TEST


The sample was installed onto a concrete wall in its normal application (cement to GB 175-2007). A test load was applied to the mid point of the sample which was then examined for any signs of damage.

ID	Weight/ downward load (kg)	Test duration (min)	Break/failure/ deflection/crack
Sample	150	30	Nil

Remark: Pass

Date: 22 Jul., 2019 Authorized signature: _____

Nutek Systems is a testing agency, accepted by the Water Supplies Department, for testing water supply fittings.


NG DICK TIK LUN
(Test Engineer)